NOTES:

1. DIMENSIONS ARE IN INCHES.
   METRIC EQUIVALENTS IN BRACKETS [ ] ARE IN MILLIMETERS.
2. DOORS ARE ON LEFT SIDE FOR UNITS 4' WIDE AND LESS.
   DOORS ARE ON BOTH SIDES FOR UNITS WIDER THAN 4'.
3. JOINTS ARE SEALED WITH LATEX SEALANT.
4. DOORS ARE SEALED WITH COMPRESSIBLE GASKET.
5. MINIMUM DOOR CLEARANCE IS 30" [762 mm].
6. BOLT PATTERN MATCHES 150 LB ASA FLANGE.
   THE FLANGE IS FOR PIPING CONNECTION AND IS NOT A SUPPORT POINT FOR PIPING.
7. UNITS ARE OF WEATHERPROOFED CONSTRUCTION.

PURAFIL, INC. REP.: _____

RIGHT SIDE

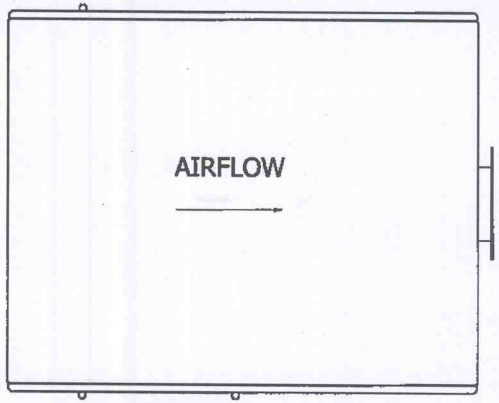

LEFT SIDE

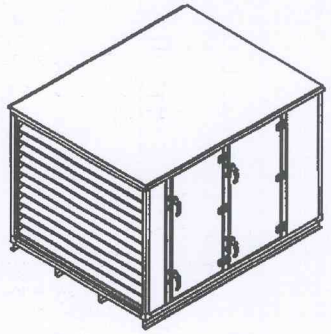

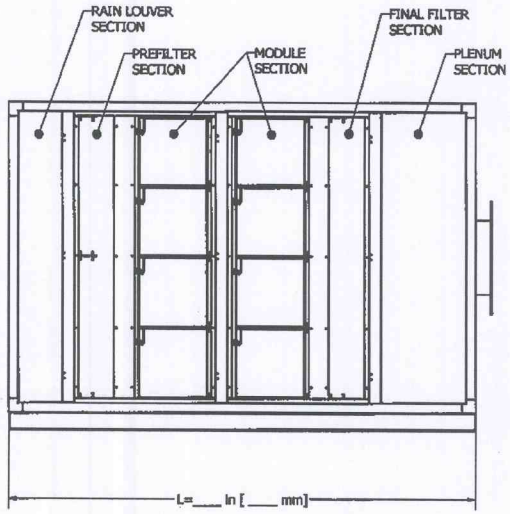

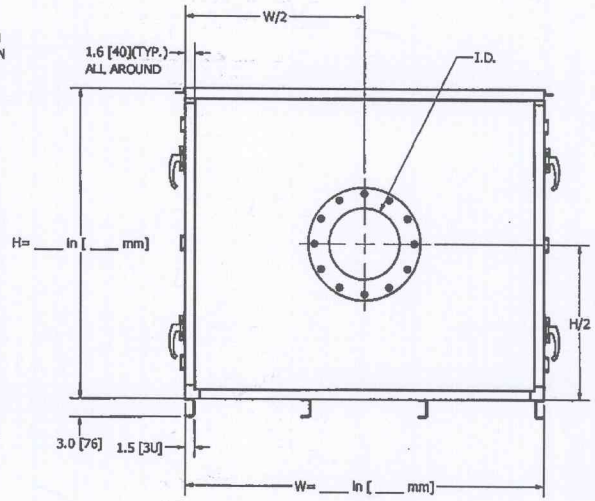

PURAFIL, INC. RESERVES THE RIGHT TO MODIFY DESIGN FOR IMPROVED PRODUCT PERFORMANCE.
3U5A)'/®, 3U5A)'/® 6(/(87, 3U5A)'/® 63, 3(50A625B®, &H/252625B® '', 3U5A&A5B®, 3U5A' 2/®, 21GUA5' ®, 3U5A)'/7(5® A1' 6&227(5® 6' UNK EMBLEM (REG. US. 3A7. &70 2))'&(), (1(56AV(™, 30™ 02' U/(6(5'(6, 0(' 'A3A' ™ 02' U/(6(5'(6, J-75A&' ™, 02/(™, 2' 252X'' A17™ 63, 2' 250'X™ 63, 2' 25&A5B™ '', 2' 25' 2/™, A1' &62™ A5(75A' (0AS' 62) 3U5A)'/®'1&., A U.6.A. &25325A7'21.

PURAFIL
First...in clean air

JOB/UNIT IDENTIFICATION:

DOUBLE WALL COMPRESSOR INTAKE FILTRATION UNIT

MODEL NUMBER:	DWCIF
	MATERIAL: / FINISH:
FRAME:	
PANELS:	

AIRFLOW:	I△P:	T△P:
ft3/min [m3/hr]	iwg [Pa]	iwg [Pa]

PREFILTERS:

QUANTITY	TYPE	SIZE

PURAFIL® AIR PURIFICATION MEDIA(S) IN DIRECTION OF AIRFLOW:

MODULE QUANTITY	MODULE TYPE	MEDIA TYPE	TOTAL MEDIA WEIGHT

FINAL FILTERS:

QUANTITY	TYPE	SIZE

GAGE UNITS:

- ☐ NONE
- ☐ ROOM PRESSURIZATION AND AIRFLOW
- ☐ STATIC PRESSURE DIFFERENTIAL (PREFILTER & FINAL FILTER)

- ☐ FOR APPROVAL
- ☐ FOR CONSTRUCTION
- ☐ FOR QUOTE
- ☐ FOR INFORMATION
- ☐ AS BUILT

DATE: 2/24/2006	REV. DATE: 7/3/2006
OPERATING WEIGHT: ___ LB [___ KG]	APPR. BY:
DRAWING NUMBER: 8017	REVISION: A

THIS DRAWING IS THE PROPERTY OF PURAFIL, INC. AND IS NOT TO BE REPRODUCED OR COPIED IN WHOLE OF IN PART. IT IS ONLY TO BE USED FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN AND IS NOT TO BE USED IN ANY OTHER PROJECT. IT IS TO BE RETURNED UPON REQUEST.